


SECTION 122.02

FIRE SERVICES (TYPICAL) CASE II

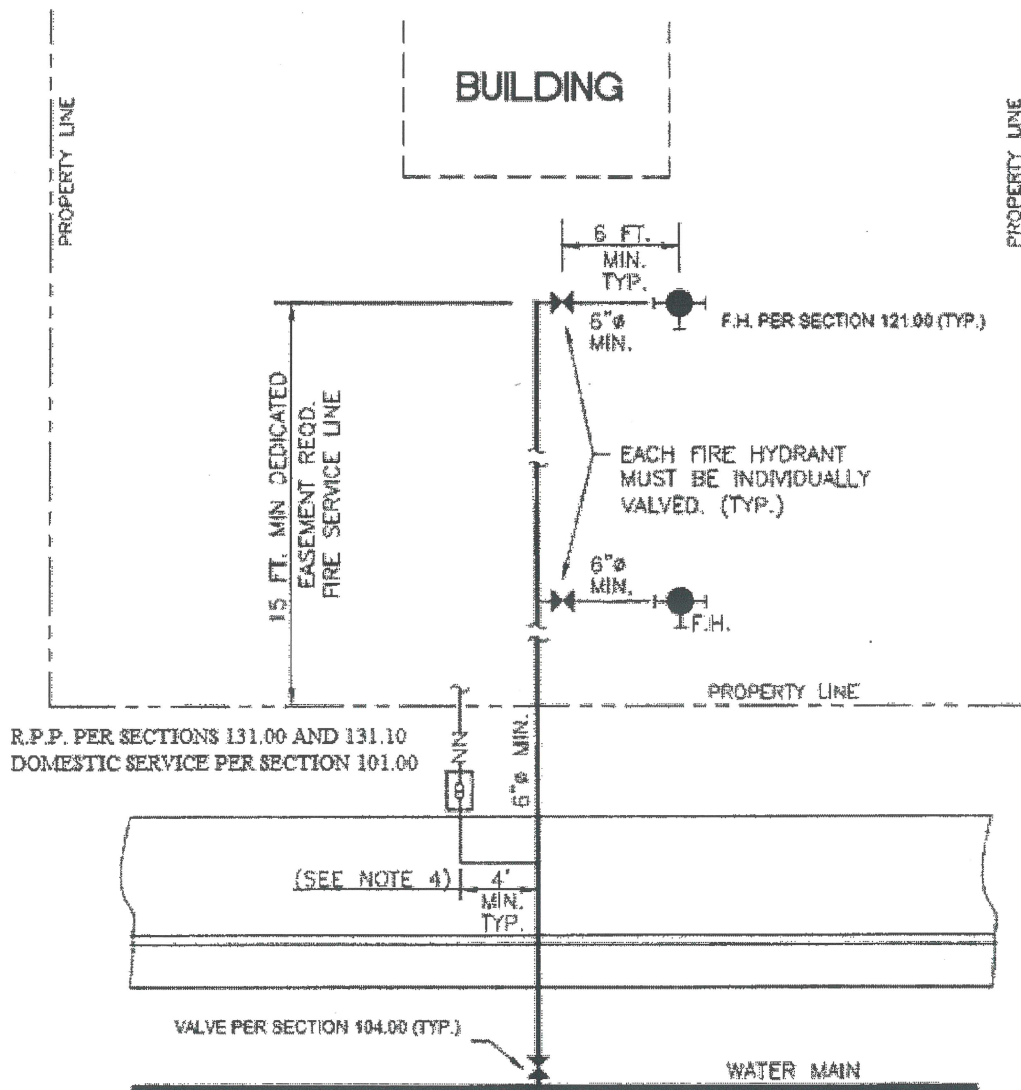

CASE II
FIRE SERVICE WITH HYDRANTS ONLY

NOTES:

1. Fire service piping and appurtenances shall be inspected within the right-of-way by the District Inspector and on private property by the Fire Department Inspector.
2. Locating wire shall be installed with all non-metallic piping and shall include pipe run to hydrant.
3. For pipe requirements see materials list, Item 1, Section 100.00.
4. Domestic Service (D.S.) shall be outside of fire service easement when provided.
5. The Reduced Pressure Principle (RPP) and waterlines shall be sized to satisfy site specific fire flow requirements.

Section 122.02 – Fire Services (Typical) Case II
August 19, 2020
Centerville CSD

Approved : 
District Manager