


## SECTION 122.03

### FIRE SERVICES (NON-TYPICAL) CASE III

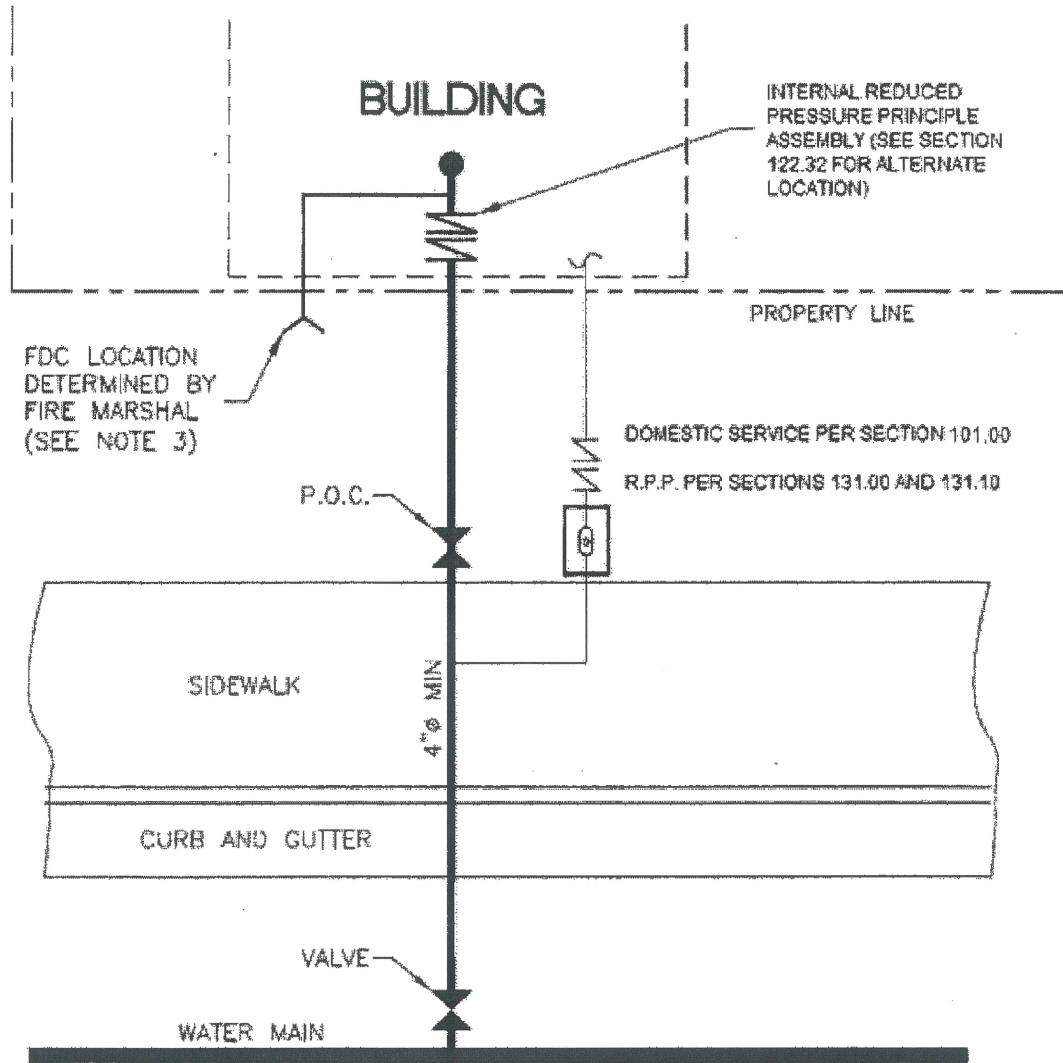

### CASE III

FIRE SERVICE WITH HYDRANT AT INTERNAL LOCATION

#### NOTES:

1. This internal, alternate location installation shall only be allowed with prior written approval from the District.
2. Fire Department Connections (FDC) shall be 'FM' or 'UL' listed.
3. Distance between FDC and fire hydrant shall be 40-foot maximum unless approved by the Fire Department.
4. When valves are required on the fire service line, indicator type valves shall be 'FM' or 'UL' listed and shall be approved both by the District Engineer and the Fire Department.
5. Fire Service Piping and Appurtenances shall be inspected within the right-of-way by the District Inspector and on private property by the Fire Department Inspector.
6. Locating wire shall be installed with all non-metallic piping and shall include pipe run to hydrant.

Section 122.03 – Fire Services (Non-Typical Case III)  
August 19, 2020  
Centerville CSD

Approved :

  
District Manager