


SECTION 132.30

BACKFLOW PREVENTION ASSEMBLY ENCLOSURE – “N” PATTERN 3” THROUGH 10”

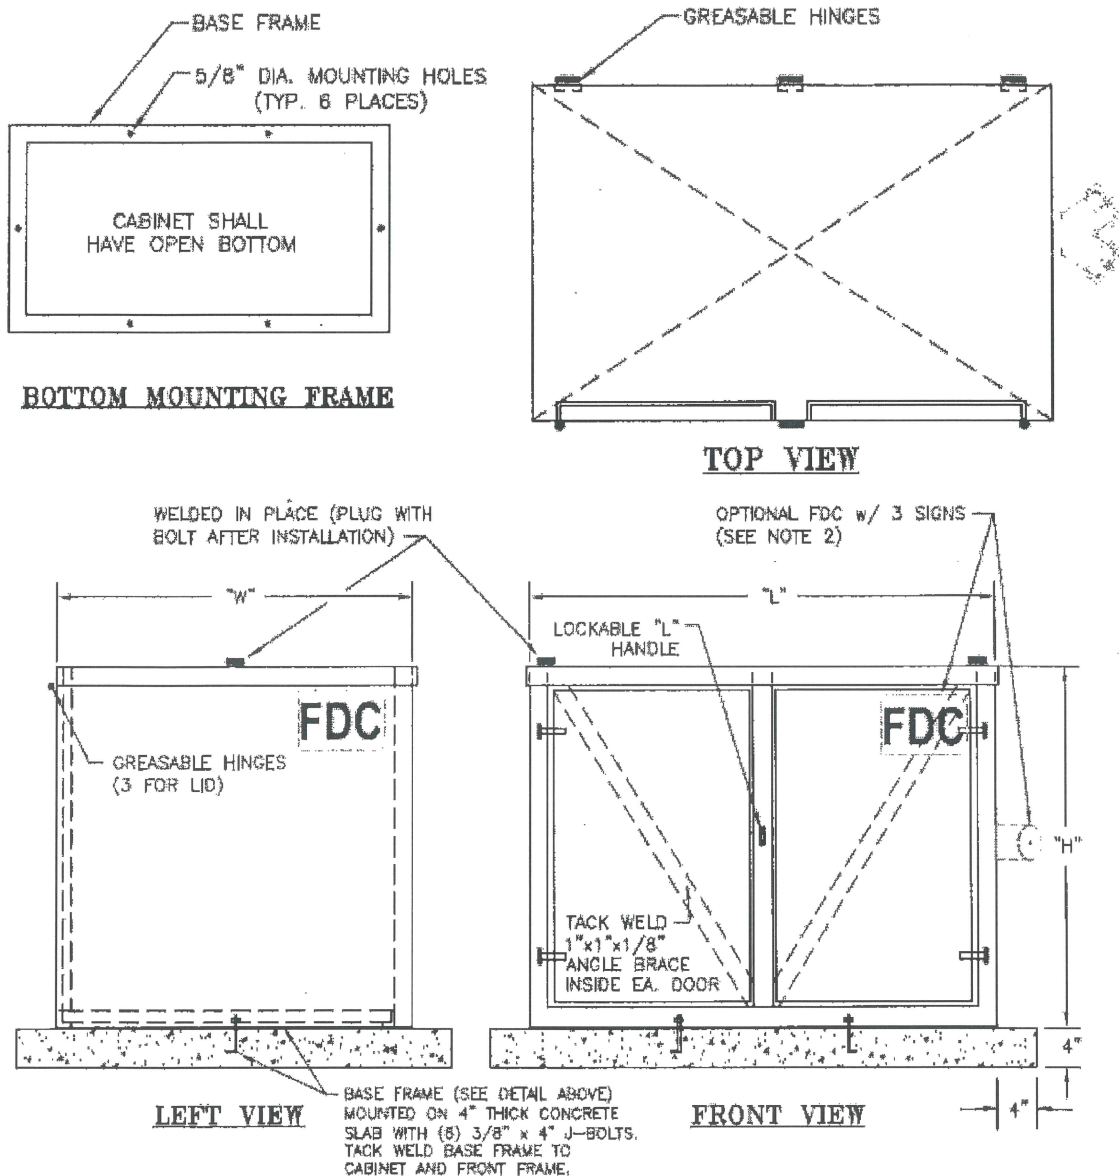

NOTES:

1. Cabinet and doors to be 14-gauge steel, painted olive-green powder coat paint inside and out.
2. When a fire department connection (FDC) is included in Backflow assembly, a sign shall be installed on the three (3) sides of the enclosure visible from the street, in the upper corner as shown. The signs shall read "FDC" in 6" high, red reflective block lettering.
3. Cabinet dimensions shall be of adequate size to provide sufficient clearance to allow access to all sides for maintenance, testing, and/or removal of Backflow assembly.
4. Backflow enclosures shall meet manufacturer's specifications for all clearances and provide access for testing and maintenance as required.